


POLE LENGTH (m)	BASE BURIAL DEPTH 'D' (m)	REINF. ROD LENGTH (m)
3.0	1.50	H + 1.35
5.6	2.15	H + 2.00
7.0	2.15	H + 2.00
7.5	2.15	H + 2.00
8.7	2.45	H + 2.30
9.0	2.45	H + 2.30
10.5	2.60	H + 2.45
12.0	2.75	H + 2.60
13.6	2.90	H + 2.75
15.1	3.05	H + 2.90

CLASSICA 460R  
CLASSICA 610R

- NOTES:
1. ALL DIMENSIONS ARE IN MILLIMETRES OR METRES
  2. TOP OF FOUNDATION SHALL BE TROWELLED SMOOTH & LEVEL.
  3. CLASS OF CONCRETE SHALL BE 25mPa. CONCRETE SHALL BE VIBRATED.
  4. MINIMUM OF TWO SLEEVES REQUIRED FOR EACH CONC. FOUNDATION UNLESS OTHERWISE SHOWN.

5. PROVIDE A 19mm DIA. 3000mm STEEL COPPER COATED GROUND ROD ADJACENT TO POLES AS SPECIFIED ON PLAN AND CONNECT TO METAL POLE WITH BARE COPPER CONDUCTOR.
6. CONTRACTOR TO VERIFY OPENING SIZE IN POLE BASE PLATE PRIOR TO SETTING CONDUIT SLEEVES.
7. SUBJECT TO SOIL CONDITIONS, REFER TO SOIL REPORT.
8. FORM RELEASE AGENT HAS BEEN FACTORY-APPLIED TO INSIDE SURFACE OF "ArtFORM".

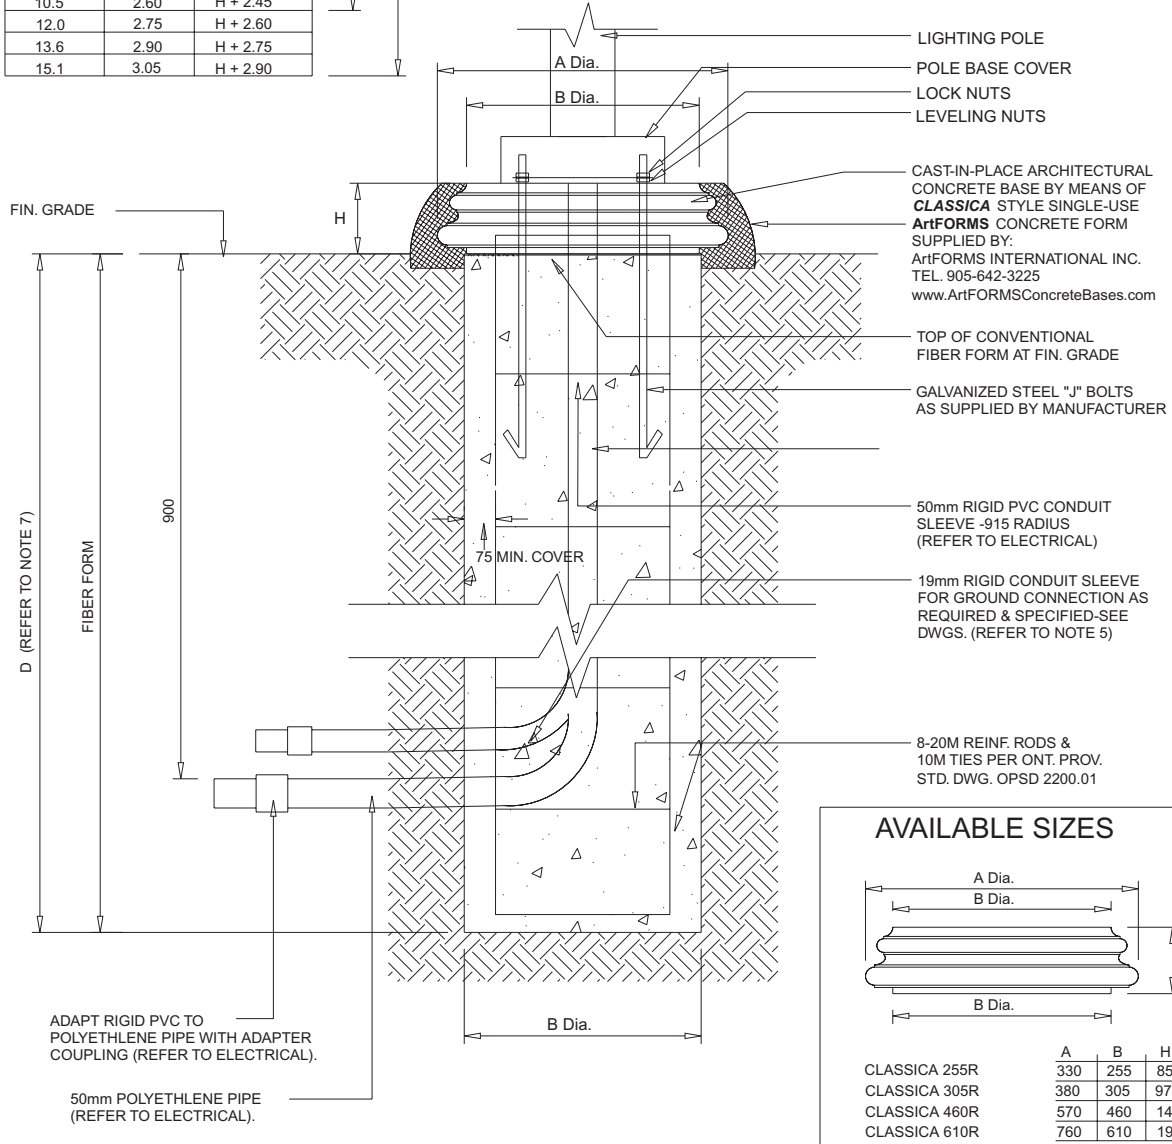

**ArtFORMS®**  
**CLASSICA**  
255R, 305R,  
460R, 610R

NOTE:  
Where applicable, this detail drawing should be modified to meet local requirements.

DRAWING TITLE  
**LIGHTING POLE, FLAGPOLE,  
BOLLARD, FLOODLIGHT,  
SIGN AND COLUMN BASE**

DATE	JOB NO.	SCALE	DWG. NO.